



ILLUSTRATIVE DTLS. ONLY
EXT. OR INT. FINISHES
NOT BY NUAIR

1BY OR 2BY WOOD BUCK MUST
COMPLY WITH CHAPTER 17
OF THE FBC.

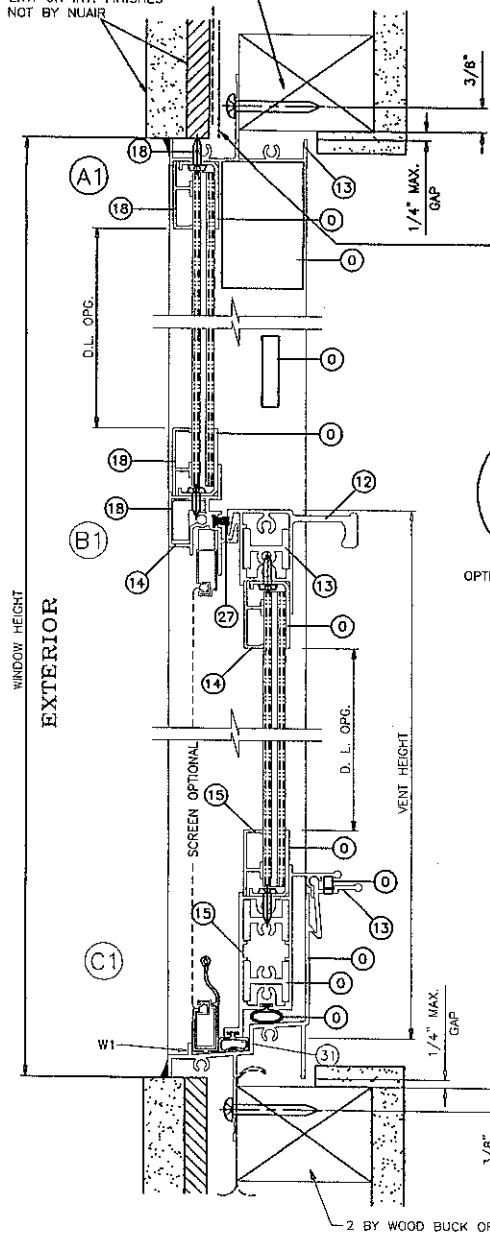

--- WEATHER RESISTANT BARRIER
--- FLEXIBLE FLASHING

WEATHERPROOFING:
FLEXIBLE FLASHING SHOULD BE INSTALLED IN A WEATHERBOARD FASHION. THE TOP LAYER SHOULD OVERLAY ANY LAYER UNDERNEATH IT. THE WEATHER RESISTANT BARRIER SHOULD THEN COVER THE FLEXIBLE FLASHING AT THE HEADER. THE APPLICATION OF THE WEATHER RESISTANT BARRIER WILL VARY BASED ON WHEN IT IS INSTALLED. IF INSTALLED AFTER THE WINDOW, IT SHOULD BE TUCKED UNDER THE SILL FLASHING AND OVERLAP THE JAMBS AND HEAD FLASHING.




FIN FRAME WINDOW

FAILURE TO SUPPORT THE FRAME USING SHIMS AT EACH FASTENER MAY RESULT IN GLASS BREAKAGE.

INSTALLER MUST USE GUNNABLE SEALANTS THAT SHALL COMPLY WITH ASTM C 920 CLASS 25 SPECIFICATION OR GREATER FOR PROPER JOINT EXPANSION AND CONTRACTION.


APPROVED MULLION
SEE SEPARATE NOA



TYPICAL ANCHORS:
#8 X 1-3/4" SMS OR DRYWALL SCREWS
INTO WOOD FL # 0027689
1-3/8" MIN. PENETRATION INTO WOOD

#10 SMS OR SELF DRILLING SCREWS
INTO APPROVED MULLIONS
(NO SHIM SPACE)

WEEPHOLES:
W1 = 1-1/2" LONG NOTCH AT SCREEN RETAINING LEG
AT EACH END OF SILL.

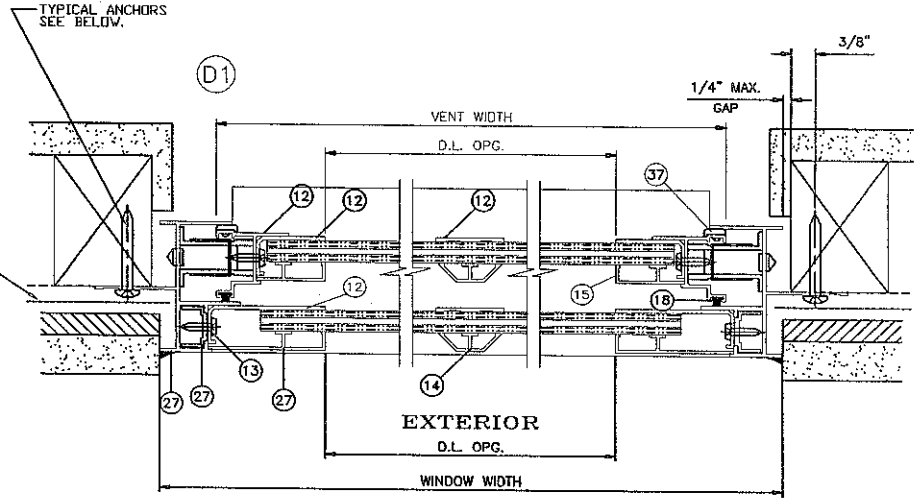

ANCHORS TO BE SPACED AS FOLLOWS:
-ALL ANCHORS TO BE EQUAL OR LESS THAN 4" FROM EACH CORNER.
-1/4" MASONRY ANCHORS TO BE EQUAL OR NO MORE THAN 23" CENTER TO CENTER, OR AT PRE-PUNCHED LOCATIONS.
-SM SCREWS INSTALLED THROUGH FIN FRAMES TO EQUAL OR NO MORE THAN 22" CENTER TO CENTER.
-DECKING SCREWS INSTALLED THROUGH FIN FRAMES TO BE EQUAL OR NO MORE THAN 10" CENTER TO CENTER.

WOOD BUCKS NOT BY NUAIR, (BORATE P.T. RECOMMENDED)
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.



SERIES-9000 ALUM SINGLE HUNG WINDOW (IMPACT)
NUAIR WINDOWS AND DOORS
8105 ANDERSON ROAD
TAMPA, FL. 33664
TEL. (800) 282-6627 FAX (813) 886-9737

AND SEALED TO BE VALID.
James B. Whittum, P.E.
FL # 0027689
8533 Acorn Ridge Ct.
Tampa, Florida 33625
813-926-9719

James B. Whittum
OCT 3 2005

THIS DOCUMENT MUST BE SIGNED

Revisions:	no	date	by	description

date: 06/09/05
scale: 1/2" = 1"
dr. by: JR
chk. by:

drawing no.
SH9000
SHEET 3